


Asti


Technical sheet



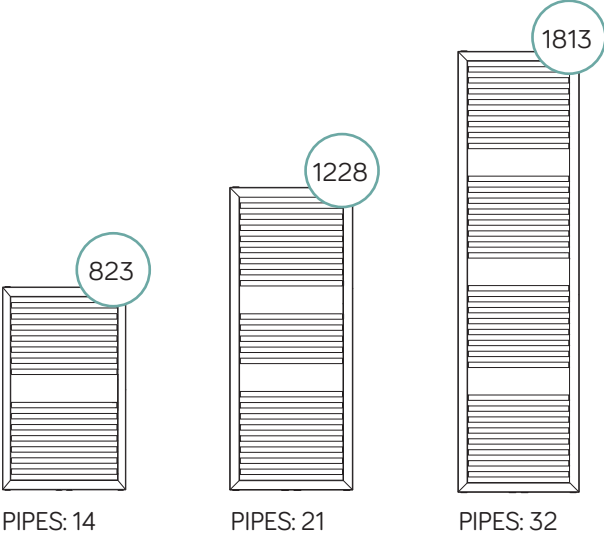


Description	Straight
Material	Carbon steel
Pipes - Ø	22x0,9
Collectors - mm	40x30x1,5
Connections	5x1/2" (air bleeding valve connection, included)
Wall fixings	4
Max operating pressure	8 bar
Max operating temperature	90 °C
Paint	Epoxy polyester powder
Packaging	Nylon bag, carton box and protections
Standard equipment	1 kit wall fixing brackets - 1 air bleeding valve - 2 blind plugs


Connection

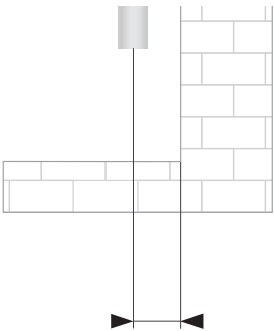

Min.	Max
60	70




Wall distance

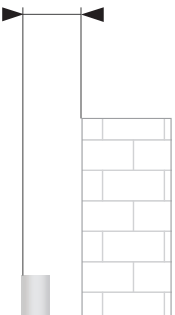

Min.	Max
75	85

Interaxis

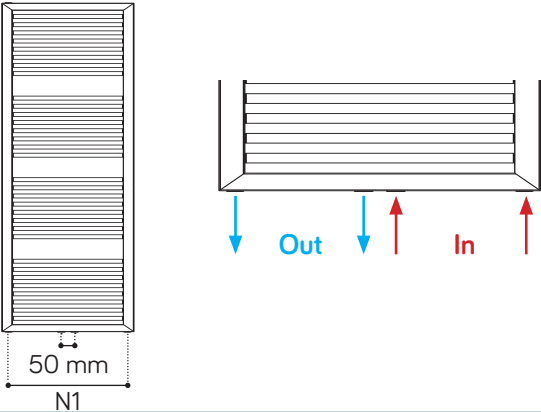

White RAL9016 - straight

Code	Height mm	Width mm	Interaxis N1 mm	Weight kg	Water lt	$\Delta T_{50}^{\circ C}$ Watt	$\Delta T_{30}^{\circ C}$ Watt	$\Delta T_{42,5}^{\circ C}$ Watt	$\Delta T_{60}^{\circ C}$ Watt	Exponent n
384837	823	500	450	6,9	4,3	395	212	324	494	1,2233
384838	823	600	550	7,8	4,9	480	257	394	600	1,21884
384839	1228	500	450	9,5	5,9	586	310	479	736	1,24662
384840	1228	600	550	10,7	7	690	367	565	865	1,23404
384841	1813	500	450	13,5	8,6	861	460	706	1077	1,22679
384842	1813	600	550	15,3	9,9	1007	533	823	1265	1,24772

Anthracite VOV12 - straight

Code	Height mm	Width mm	Interaxis N1 mm	Weight kg	Water lt	$\Delta T_{50}^{\circ C}$ Watt	$\Delta T_{30}^{\circ C}$ Watt	$\Delta T_{42,5}^{\circ C}$ Watt	$\Delta T_{60}^{\circ C}$ Watt	Exponent n
384843	823	500	450	6,9	4,3	395	212	324	494	1,2233
384844	823	600	550	7,8	4,9	480	257	394	600	1,21884
384845	1228	500	450	9,5	5,9	586	310	479	736	1,24662
384846	1228	600	550	10,7	7	690	367	565	865	1,23404
384847	1813	500	450	13,5	8,6	861	460	706	1077	1,22679
384848	1813	600	550	15,3	9,9	1007	533	823	1265	1,24772

Chrome - straight

Code	Height mm	Width mm	Interaxis N1 mm	Weight kg	Water lt	$\Delta T_{50}^{\circ C}$ Watt	$\Delta T_{30}^{\circ C}$ Watt	$\Delta T_{42,5}^{\circ C}$ Watt	$\Delta T_{60}^{\circ C}$ Watt	Exponent n
384849	823	500	450	7,0	4,3	286	152	234	359	1,24141
384850	823	600	550	7,8	4,9	331	177	272	414	1,21904
384851	1228	500	450	9,7	5,9	393	209	322	493	1,23643
384852	1228	600	550	10,9	7	462	241	376	583	1,27219
384853	1813	500	450	13,7	8,6	578	306	473	726	1,24294
384854	1813	600	550	15,3	9,9	690	364	564	867	1,2497

Our radiators are tested in qualified laboratories according to EN-442 regulations which determine the output value by fixing the ΔT at 50 °C. ΔT is the difference between the average temperature of the water inside the radiator and the room temperature. The formula is: $\left(\frac{(T_1+T_2)}{2}-T_3\right)$.

Ex.: $((75+65)/2)-20=50^{\circ C}$. For output values with a different ΔT use the following formula: $\phi_x = \phi_{\Delta T50} * (\Delta T_x/50)^n$.

See calculation example of the output at ΔT 60 °C of article 384837: $395*(60/50)^{1,2233}=494$.

Output values in kcal/h = watt x 0,85984.

Output values in btu = watt x 3,412.

KEY

T_1 = supply temperature - T_2 = return temperature - T_3 = room temperature.

ϕ_x = output to be calculated - $\phi_{\Delta T50}$ = output at ΔT 50 °C (table) - $\Delta T_x = \Delta T$ value to be calculated - n = exponent "n" (table).